
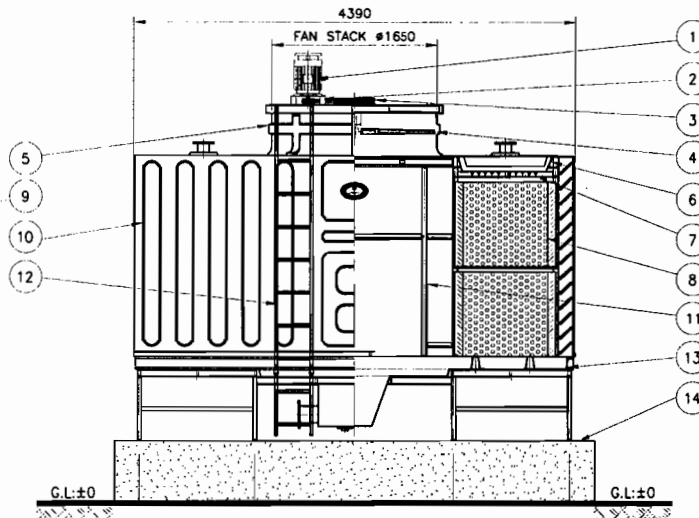


Concrete Foundation

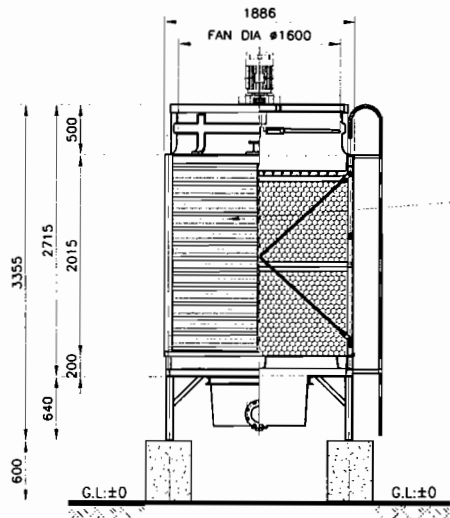

NO	DESCRIPTION	MATERIAL	Q'TY	SIZE	REMARKS
1	MOTOR	T.E.F.C	1SET	5HPx4P	
2	V-BELT	RUBBER	1SET	150R/T	
3	REDUCER	FC	1SET	150R/T	
4	FAN ASS'Y	F.R.P	1SET	ø1600	
5	FAN STACK	F.R.P	1SET	ø1640	
6	HOT WATER BASIN	F.R.P	2SETS	4t	
7	NOZZLE	P.P	1SET	ø15	
8	FILLER/ELIMINATOR	P.V.C	1SET	0.4t	
9	LOUVER	A.B.S	1SET	150R/T	
10	CASING	F.R.P	1SET	3t	
11	STRUCTURE	SS400	1SET	4t	H.D.G
12	LADDER	S.P.P	1SET	20A	H.D.G
13	COLD WATER BASIN	F.R.P	1SET	4t	
14	FOUNDATION	CON'C	1LOT	-	OUT OF SCOPE

SPECIFICATION DATA			LOADING DATA
1	CIRCULATING WATER FLOW	117M <sup>3</sup> /HR (150R/T)	SHIPPING WEIGHT 1550KG
2	HOT WATER TEMPERATURE	37°C	
3	COLD WATER TEMPERATURE	32°C	OPERATING WEIGHT 3580KG
4	WET BULB TEMPERATURE	27°C	
5	NOMINAL CAPACITY	585,000Kcal/hr	

PIPE SPECIFICATION DATA			
NO	NAME	SIZE	CONNECTION
A	INLET PIPE	100Ax2	FLANGE
B	OUTLET PIPE	150Ax1	FLANGE
C	DRAIN PIPE	50Ax1	SOCKET
D	AUTOMATIC MAKE UP	32Ax1	SOCKET
E	MANUAL MAKE UP	32Ax1	SOCKET
	OVER FLOW	50Ax1	SOCKET

NO.	REVISION	DATE	DRAWN	CHK'D	APP'R	REFERENCE DRAWING
△						
△						
△						

**DHT D H Tech Co., Ltd.**  
 디에이치테크(주)

Project NO. \_\_\_\_\_  
 Scale N/S \_\_\_\_\_  
 Unit mm \_\_\_\_\_  
 Date \_\_\_\_\_  
 Size A3

Drawn \_\_\_\_\_  
 Design \_\_\_\_\_  
 Checked \_\_\_\_\_  
 Approved \_\_\_\_\_

PROJECT : COOLING TOWER  
 CROSS FLOW TYPE.

TITLE :  
**DHG-CR-150**

DWG. NO. \_\_\_\_\_  
 Rev. No. \_\_\_\_\_