
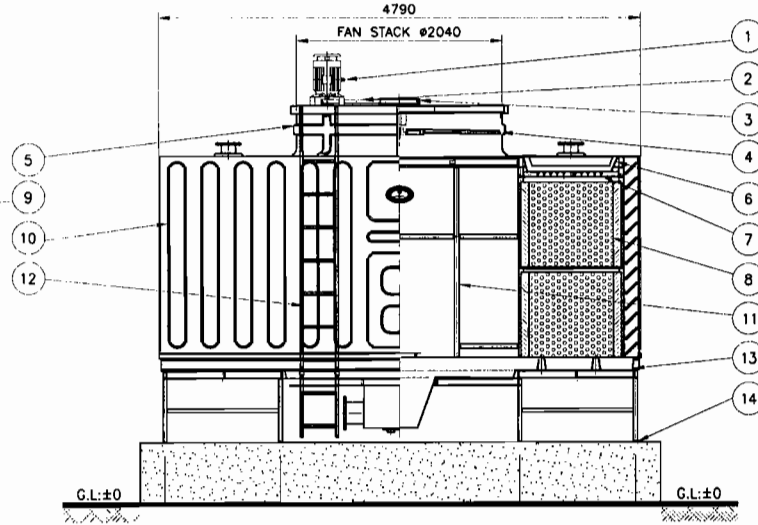


Concrete Foundation

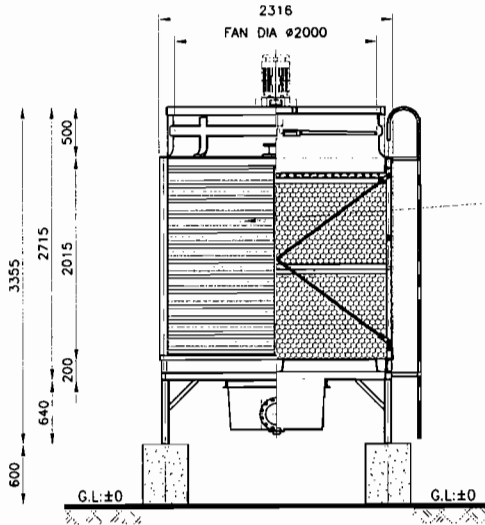

NO	DESCRIPTION	MATERIAL	Q'TY	SIZE	REMARKS
1	MOTOR	T.E.F.C	1SET	10HPx4P	
2	V-BELT	RUBBER	1SET	250R/T	
3	REDUCER	FC	1SET	250R/T	
4	FAN ASS'Y	F.R.P	1SET	φ2000	
5	FAN STACK	F.R.P	1SET	φ2040	
6	HOT WATER BASIN	F.R.P	2SETS	4t	
7	NOZZLE	P.P	1SET	φ15	
8	FILLER/ELIMINATOR	P.V.C	1SET	0.4t	
9	LOUVER	A.B.S	1SET	250R/T	
10	CASING	F.R.P	1SET	3t	
11	STRUCTURE	SS400	1SET	4t	H.D.G
12	LADDER	S.P.P	1SET	20A	H.D.G
13	COLD WATER BASIN	F.R.P	1SET	4t	
14	FOUNDATION	CON'C	1LOT	-	OUT OF SCOPE

SPECIFICATION DATA			LOADING DATA
1	CIRCULATING WATER FLOW	195M ³ /HR (250R/T)	SHIPPING WEIGHT 1850KG
2	HOT WATER TEMPERATURE	37°C	
3	COLD WATER TEMPERATURE	32°C	OPERATING WEIGHT 4520KG
4	WET BULB TEMPERATURE	27°C	
5	NOMINAL CAPACITY	975,000Kcal/hr	

PIPE SPECIFICATION DATA			
NO	NAME	SIZE	CONNECTION
A	INLET PIPE	125Ax2	FLANGE
B	OUTLET PIPE	200Ax1	FLANGE
C	DRAIN PIPE	50Ax1	SOCKET
D	AUTOMATIC MAKE UP	40Ax1	SOCKET
E	MANUAL MAKE UP	40Ax1	SOCKET
	OVER FLOW	65Ax1	SOCKET

NO.	REVISION	DATE	DRAWN	CHK'D	APP'R	REFERENCE DRAWING
△						
△						
△						

DH Tech Co., Ltd.
 디에이치테크(주)

Project NO. _____
 Scale N/S _____
 Unit mm _____
 Date _____
 Size A3 _____

Drawn _____
 Design _____
 Checked _____
 Approved _____

PROJECT : COOLING TOWER
 CROSS FLOW TYPE.

TITLE : **DHG-CR-250**

DWG. NO. _____ Rev. No. _____