
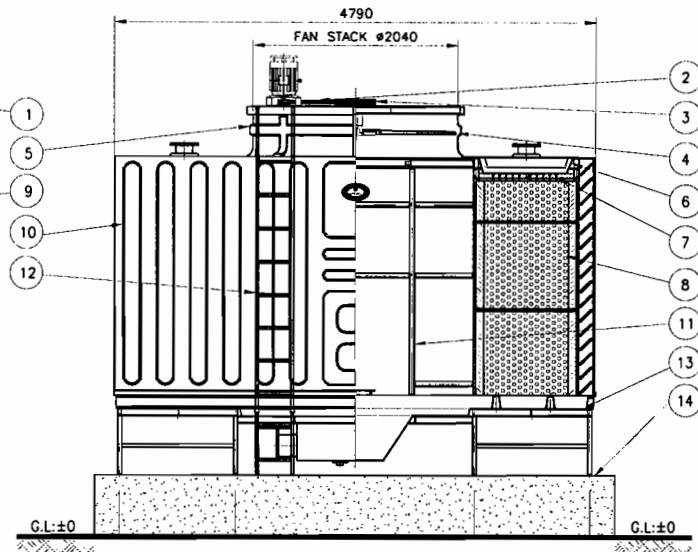


NO	DESCRIPTION	MATERIAL	Q'TY	SIZE	REMARKS
1	MOTOR	T.E.F.C	2SET	10HPx4P	
2	V-BELT	RUBBER	2SET	300R/T	
3	REDUCER	FC	2SET	300R/T	
4	FAN ASS'Y	F.R.P	2SET	ø2000	
5	FAN STACK	F.R.P	2SET	ø2040	
6	HOT WATER BASIN	F.R.P	4SETS	4t	
7	NOZZLE	P.P	2SET	ø15	
8	FILLER/ELIMINATOR	P.V.C	2SET	0.4t	
9	LOUVER	A.B.S	2SET	300R/T	
10	CASING	F.R.P	2SET	3t	
11	STRUCTURE	SS400	2SET	4t	H.D.G
12	LAOOR	S.P.P	1SET	20A	H.D.G
13	COLD WATER BASIN	F.R.P	2SET	4t	
14	FOUNDATION	CON'C	1LOT	-	OUT OF SCOPE

SPECIFICATION DATA			LOADING DATA
1	CIRCULATING WATER FLOW	468M ³ /HR (600R/T)	SHIPPING WEIGHT 4180KG
2	HOT WATER TEMPERATURE	37°C	
3	COLD WATER TEMPERATURE	32°C	OPERATING WEIGHT 9340KG
4	WET BULB TEMPERATURE	27°C	
5	NOMINAL CAPACITY	2,340,000Kcal/hr	

PIPE SPECIFICATION DATA			
NO	NAME	SIZE	CONNECTION
A	INLET PIPE	125Ax4	FLANGE
B	OUTLET PIPE	200Ax2	FLANGE
C	DRAIN PIPE	50Ax2	SOCKET
D	AUTOMATIC MAKE UP	40Ax2	SOCKET
E	MANUAL MAKE UP	40Ax2	SOCKET
	OVER FLOW	65Ax2	SOCKET

Concrete Foundation

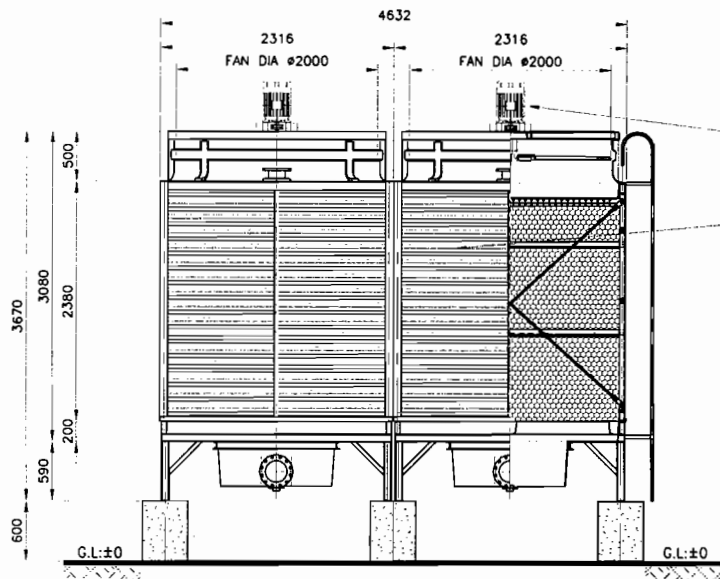

DNT D H Tech Co., Ltd.
 디에이치테크 (주)

PROJECT : COOLING TOWER
 CROSS FLOW TYPE.

TITLE : **DHG-CR-600**
(300R/TX2CELL)

DWG. NO. _____ Rev. No. _____

Project NO.		
Scale	H/S	Drawn
Unit	mm	Design
Date		Checked
Size	A3	Approved

NO.	REVISION	DATE	DRAWN	CHK'D	APP'R	REFERENCE DRAWING
△						
△						
△						
△						