
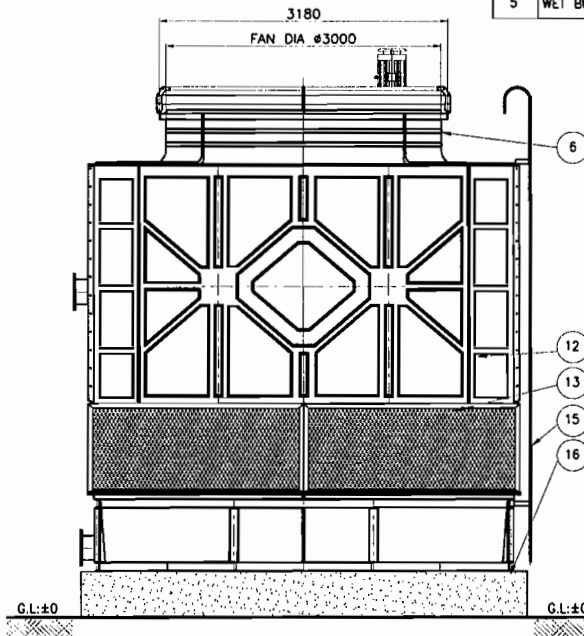


NO	DESCRIPTION	MATERIAL	Q'TY	SIZE	REMARKS
1	MOTOR	T.E.F.C	2SET	20HPx4P	
2	V-BELT	RUBBER	2SET	500R/T	
3	MOTOR SUPPORT	SS400	2SET	6t	H.D.G
4	REDUCER	FC	2SET	500R/T	
5	FAN BLADE	F.R.P	2SET	φ3000	
6	FAN STACK	F.R.P	2SET	φ3030	
7	ELIMINATOR	P.V.C	2SET	P.V.C	
8	NOZZLE PIPE	P.V.C or P.E	2SET	80A	
9	NOZZLE	P.P	1LOT	25A	
10	FILLER	P.V.C	1LOT	0.4t	
11	FILLER SUPPORT	SS400	2SET	6t	H.D.G
12	CASING(BODY)	F.R.P	2SET	5t	
13	LOUVER	P.V.C	1LOT	500R/T	H.O.G
14	COLD WATER BASIN	F.R.P	2SET	5t	
15	LADDER	S.P.P.W	1SET	25A	
16	FOUNDATION	CON'C	1LOT		

SPECIFICATION DATA		LOADING DATA
1	CIRCULATING WATER FLOW	936M <sup>3</sup> /HR(1200R/T)
2	NOMINAL CAPACITY	4,680,000Kcal/hr
3	HOT WATER TEMPERATURE	37 °C
4	COLD WATER TEMPERATURE	32 °C
5	WET BULB TEMPERATURE	27 °C
		SHIPPING WEIGHT
		9560KG
		OPERATING WEIGHT
		23800KG

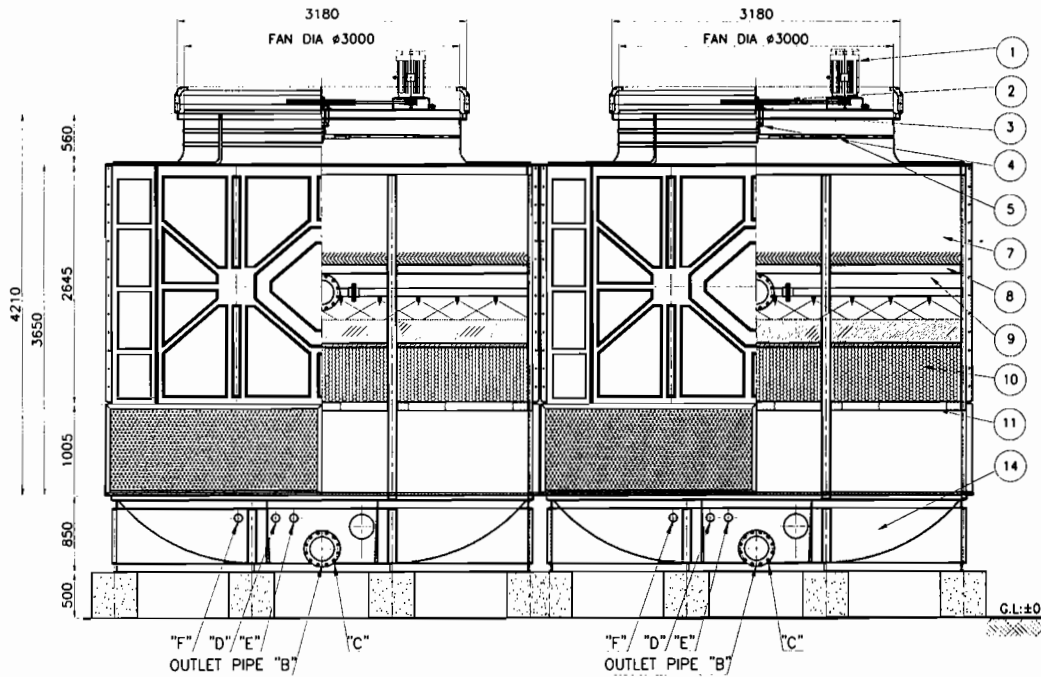

PIPE SPECIFICATION DATA			
NO	NAME	SIZE	CONNECTION
A	INLET PIPE	250A	FLANGE
B	OUTLET PIPE	250A	FLANGE
C	DRAIN PIPE	80A	SOCKET
D	AUTOMATIC MAKE UP	80A	SOCKET
E	MANUAL MAKE UP	80A	SOCKET
F	OVER FLOW	100A	SOCKET

NO.	REVISION	DATE	DRAWN	CHK'D	APP'R	REFERENCE DRAWING
△						
△						
△						
△						

**DHT** Dae Hwa Tech Co., Ltd.  
 다에이테크(주)

Project NO. \_\_\_\_\_  
 Scale N/S \_\_\_\_\_  
 Unit mm \_\_\_\_\_  
 Date \_\_\_\_\_  
 Size A4 \_\_\_\_\_

Drawn \_\_\_\_\_  
 Design \_\_\_\_\_  
 Checked \_\_\_\_\_  
 Approved \_\_\_\_\_

PROJECT : COOLING WATER SYSTEM

TITLE : DHG-CU-1000

DWG. NO. \_\_\_\_\_ Rev. No. \_\_\_\_\_